

## Domekt CF 200 V

|   |            |
|---|------------|
| Maximal air flow, m <sup>3</sup> /h                             | 202        |
| Unit weight, kg   | 42         |
| Supply voltage, V   | 1~230      |
| Maximal operating current, A                                    | HE8,3      |
| Thermal efficiency of heat recovery, %                          | 92         |
| Reference flow rate, m <sup>3</sup> /s                          | 0,039      |
| Reference pressure difference, Pa                               | 50         |
| SPI, W/(m <sup>3</sup> /h)                                      | 0,22       |
| Filters dimensions BxHxL, mm                                    | 365×132×46 |
| Electric power input of the fan drive at reference flow rate, W | 15         |
| Electric power input of the fan drive at maximum flow rate, W   | 37         |
| Electric air heater capacity, kW / Δt, °C                       | 0,5 / 9,8  |
| Electric preheater capacity, kW / Δt, °C                        | 1 / 19,6   |
| Control panel   | C6.1 / 6.2 |
| Maintenance space, mm   | 600        |

### Acoustic data

A-weighted sound power level L<sub>WA</sub>, dB(A) at reference flow rate

|                |    |
|----------------|----|
| Supply inlet   | 45 |
| Supply outlet  | 59 |
| Exhaust inlet  | 45 |
| Exhaust outlet | 59 |
| Casing         | 41 |


A-weighted sound pressure level L<sub>PA</sub>, dB(A)

10 m<sup>2</sup> normally isolated room, distance from casing – 3 m.

|              |    |
|--------------|----|
| Surroundings | 30 |
|--------------|----|


### Performance

Unit with standard equipment

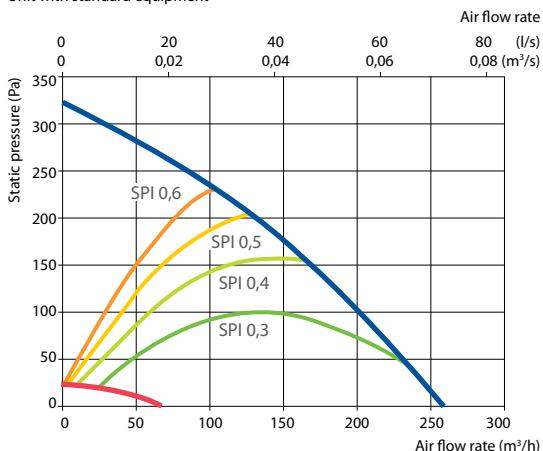

### Accessories (p. 123)

|                |  |
|----------------|--|
| Closing damper | AGUJ-M-160+LF230/LM230                       |
| Silencer       | A/D AGS-160-50-600-M<br>B/C AGS-160-50-900-M |
| Water heater   | DH-160                                       |




### Temperature efficiency

| Outside temperature, °C   | Winter |       |       |      |      | Summer |      |      |
|---------------------------|--------|-------|-------|------|------|--------|------|------|
|                           | -23    | -15   | -10   | -5   | 0    | 25     | 30   | 35   |
| After heat exchanger*, °C | 18,9*  | 19,0* | 19,0* | 19,0 | 19,6 | 22,3   | 22,9 | 23,4 |


indoor +22°C, 20 % RH.

\* calculations made after evaluation of the preheater.

Shown as right (R1)

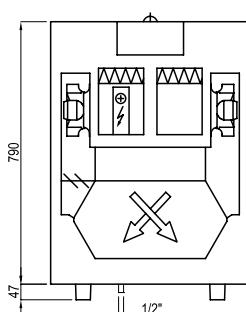

Shown as left (L1)

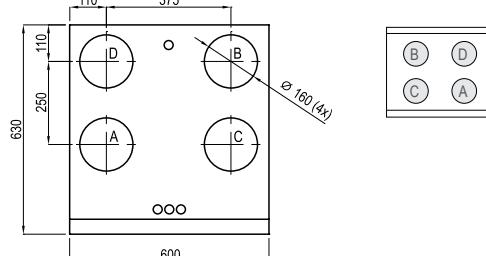

- A outdoor intake
- B supply air
- C extract indoor
- D exhaust air